

## Introduction

Continuing our look into occupancy specific building types this paper examines the unique characteristics and challenges of mitigating the spread of airborne diseases in hotel facilities.

Our primary objective will be to answer the question:

*What should I do to my hotel facility to improve the safety and comfort of my guests and employees?*

We will review the common systems types found in hotels and make recommendations for improving the infection control potential of these systems. We will also examine how well these systems can be adapted to meet the latest infection control standards and recommendations.

## Agency Recommendations

The latest recommendations from the ASHRAE Epidemic Task Force for Commercial Buildings (updated 08/17/2020) include the following improvements related to any building's HVAC system:

- Maintain temperatures in accordance with ANSI/ASHRAE Standard 55-2017.
- Maintain relative humidity between 40% and 60%.
- Verify minimum ventilation requirements per Standard 62.1 are maintained. Increase ventilation rate as allowed per installed equipment and still maintain comfort levels.
- Operate systems at maximum outside air mode for two hours before and two hours after occupied times.
- Increase filter rating to MERV-13 if equipment can handle the additional pressure loss.

<https://www.ashrae.org/technical-resources/resources>

The Centers for Disease Control and Prevention's Resuming Business TOOLKIT includes the following general recommendations for all ventilation systems:

- Increase ventilation rates or percentage of outdoor air.
- Disable demand-controlled ventilation (DCV).
- Improve filtration to MERV-13.

<https://www.cdc.gov/coronavirus/2019-ncov/community/resuming-business-toolkit.html>


## Typical Hotel HVAC System Types

Hotel facilities may be served by a wide variety of system types including, but not limited to, the following:

- Terminal units: Fan coil, WSHP, GSHP, VRF, PTACS.
- Commercial packaged roof top units.
- Central air handlers.

The central air handling systems (indoor modular, indoor self-contained and outdoor packaged roof top types) handle the introduction of fresh outside air in the equipment itself, through various forms of dampers and intake hoods. The terminal unit systems are usually paired with a dedicated outside air system or are provided with through wall louvers to obtain fresh air directly.

The system types associated with hotel facilities offer many options for improving indoor air quality and reducing the risk of the spread of contaminants and pathogens. The key is selecting the right combination of measures to achieve the optimum result for each system type, within the budget constraints of the project, while maintaining acceptable comfort levels for the occupants.

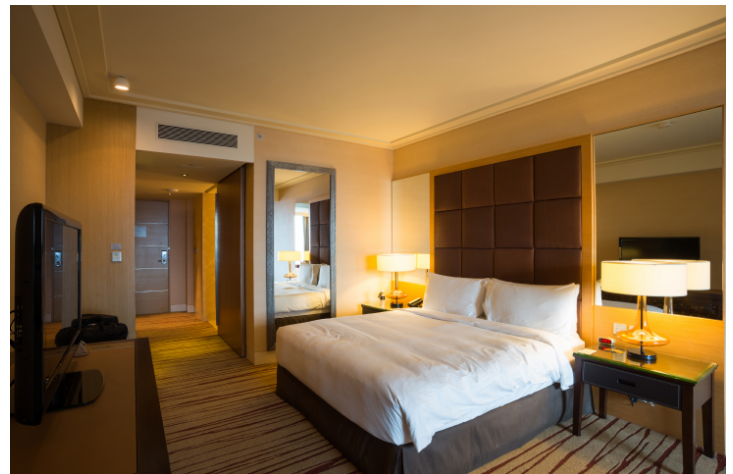

## Temperature Control

ANSI/ASHRAE Standard 55-2017 does not directly specify temperature requirements for various occupancies. This is due to the fact that occupant comfort is a very subjective matter. Different individuals have different expectations with respect to temperature and humidity in order to



# ENHANCED HVAC INFECTION CONTROL:

## HOTEL HOSPITALITY

determine if a space is considered “comfortable”. This is particularly true when considering individual hotel rooms.

Any modifications to the HVAC systems should be carefully coordinated to ensure that the end result still provides acceptable human comfort, effective infection control and satisfied customers.

Facilities personnel or qualified service contractors should verify that the temperature and humidity sensors in all areas are calibrated and operating properly, prior to embarking on an upgrade program to improve infection control.

### Ventilation Systems

ANSI/ASHRAE Standard 62.1-2019 requires a minimum of 5 cfm per person plus 0.06 cfm per square foot of floor area of outdoor air for guestrooms, 7.5 cfm per person plus 0.06 cfm per square foot of floor area for lobbies, and 5 cfm per person plus 0.06 cfm per square foot of floor area for multi-purpose rooms. These requirements translate into approximately 0.86 air changes per hour of outdoor air for the guestrooms, 1.43 air changes per hour of outdoor air for the lobby, and 3.30 air changes per hour of outdoor air for the multi-purpose areas.

While these rates would meet minimum code requirements, the air change rates of the guestrooms and lobby are not considered sufficient for the purpose of an effective dilution ventilation strategy for virus control. The multi-purpose areas required air change rate is considered sufficient, however many of these spaces are likely not performing to these levels due to energy conservation efforts and/or deferred maintenance. Therefore, even the multipurpose spaces should be tested and balanced prior to any reopening of the facilities for use.

Most recent viral control studies and the current CDC guidelines recommend a minimum of 2 to 4 air changes per hour of outdoor air to achieve a reasonable level of infectious agent dilution. See our white paper on [Dilution Ventilation](#) for further details.

Air changes per hour	Minutes required for removal efficiency	
	99%	99.9%
2	138	207
4	69	104
6	46	69
12	23	35
15	18	28
20	14	21
50	6	8
400	<1	1

Time required for infectious agent removal based on the number of air changes per hour (adapted from CDC guideline [28])

CDC Infectious Agent Dilution Ventilation Performance

Depending on the HVAC system installed and the outdoor temperature/humidity conditions, typical hotel common area systems may or may not be able to achieve a 2 to 4 air change rate, while still maintaining acceptable indoor temperatures and humidity. Therefore, the goal for the common area systems should be to achieve the maximum outdoor air ventilation rate possible at any given time without overloading the HVAC’s system ability to properly condition the air.

Guest room systems are less critical since they are typically occupied by members of the same traveling unit and are therefore not concerned about inter-person spread while inside the guest room. See the section later in this white paper about guest room disinfection systems.

### Demand Controlled Ventilation Systems

Many common area systems, particularly in newer facilities, are equipped with Demand Controlled Ventilation systems or DCV, which vary the amount of outdoor air introduced based on the measured CO<sub>2</sub> levels in the space or return air stream. These systems are design to adjust the outdoor air intake system to reflect the actual occupancy of the space at any given time, rather than simply bringing in a fixed amount of outdoor air to meet minimum code requirements. DCV systems were introduced primarily as an energy conservation measure to ensure that the central HVAC system was not



bringing in any more outdoor air than was necessary to maintain acceptable indoor air quality levels, generally defined to be <1,000 ppm total CO<sub>2</sub> concentration or <600 ppm above the outdoor ambient CO<sub>2</sub> concentration level. (Outdoor air typically contains between 350 and 450 ppm CO<sub>2</sub>.)

While the CDC has recommended *disabling* DCV systems, it is Schnackel Engineers' recommendation that they be maintained, and even installed if they are not already present, to help ensure that the maximum amount of outdoor air is being introduced during periods of high occupancy. However, in lieu of a typical pre-COVID-19 set point of 1,000 to 1,200 ppm total CO<sub>2</sub>, these systems should be lowered to a 600 ppm maximum set point to effectively double the amount of fresh air delivery to the space when the building is heavily occupied. As a general rule of thumb, a doubling of the ventilation rate will cut the concentration of contaminants in the air by approximately 50%. The system can then scale back the fresh air delivery somewhat during periods of lower occupancy or high outdoor ambient conditions, without requiring any manual intervention in the control of the system.

During periods of economizer operation (mild weather conditions), outdoor air rates rise to as high 100% of the supply air quantity, providing excellent air change rates (>10 AC/hr), better indoor air quality and lower energy costs. Any system that is not already equipped with an air side economizer, should be analyzed to determine if it can be retrofitted for both energy conservation and viral control improvement reasons.

## Dedicated Outdoor Air Systems

Terminal unit systems which rely on Dedicated Outdoor Air Systems (DOAS) may be more challenging when it comes to increasing the ventilation rate. DOAS units are typically designed to within a fairly narrow band of the code prescribed minimum outdoor air ventilation rates and therefore would require significant modifications or even unit replacement to achieve the higher ventilation

rates necessary to achieve effective airborne pathogen dilution. Such modifications may or may not be possible without significant investment in replacement systems and ductwork.


## Ventilation System Maintenance

All HVAC systems, regardless of type, should be checked to ensure that the ventilation rates delivered to the occupied spaces are as high possible without compromising comfort levels or causing undue loading on the system equipment. All dampers, motors, controls and accessories associated with the ventilation systems should be checked to ensure they are working properly, and are meeting at least the minimum code requirements, if not higher.

## Filtration

Our [Filtration White Paper](#) took an in-depth look at the available filtration technologies that can be applied to almost any HVAC system. Please refer to that white paper for more specific information about MERV ratings, filter efficiencies and the associated pressure drop considerations. The primary objective of increasing filtration with respect to infection control, is to install as high-efficiency of filters as is possible, subject to the static pressure limitations of the HVAC system.

Central air handling units and commercial package roof top units should be capable of overcoming the additional static pressure associated with the higher MERV ratings recommended for infection control. Whenever possible, install filters of a MERV-13 rating, or higher, to achieve maximum viral droplet capture. Sometimes increasing the MERV rating of the filters will require either no modifications to the HVAC equipment or minor changes to the belts, pulleys and possibly the supply fan motor, all of which can be accomplished at a relatively minor cost.



Terminal Unit systems can be more challenging when it comes to filtration. Since terminal units are relatively



small in size and therefore have smaller fans and motors, most will not be capable of handling an upgrade to a MERV-13 rating. However, the filters should still be upgraded the highest MERV rating that each unit can safely handle. Even an upgrade to MERV-8 or MERV-10 can provide a meaningful reduction in the concentration of airborne infectious particles, particularly the larger droplets that are associated with SARS-CoV-2 spread. Each system should be evaluated by an HVAC design professional to determine the optimum replacement filter efficiency.

## Humidity Control

As we learned in our [Humidity Control White Paper](#), maintaining the optimum humidity level of 40%-60% RH may be the single most effective way to mitigate the spread of viruses in buildings. This is due to both the human body's adverse reaction to low humidity and the viruses' ability to thrive and spread under low and high humidity conditions. Most hotel facilities have a reasonable capacity to dehumidify the air in the building using the air conditioning systems, however very few hotels are equipped with any type of humidification equipment to keep viral spread low during the winter months.

## Humidification Mode

Central air handling units and commercial package roof top units should be fitted with central "clean-steam" humidification systems with in-duct steam distributors for each unit. Evaporative type humidifiers should be avoided unless they are coupled with UV light sterilization systems to ensure no mold or bacterial growth can occur.


Common areas served by terminal units will need to be evaluated on a case-by-case basis. Individual humidifiers featuring in-duct steam distribution might work in some instances. However, in most cases a different approach is warranted. Humidifiers with wall-mounted distributors can be used in common areas. Countertop personal humidifiers could be provided in guestrooms, if desired.

## Dehumidification Mode

Areas served by central air handlers or packaged roof top air conditioners systems should be able to operate efficiently under part-load conditions and maintain humidity levels within the target range during the summer months. In addition, some of these systems may already be equipped with a dehumidification cycle option, utilizing either hot refrigerant gas or electric reheat to prevent over-cooling. If additional dehumidification is necessary, reheat coils can be added to the existing equipment to allow for drying of the air during light loading conditions.

## Additional Prevention Measures

In addition to the recommendations discussed above, there are several other options available to provide additional layers of infection control and prevention. Often a multi-layered approach is the best strategy to bring a building up to its maximum infection control potential. These measures can include the following:

- [In-Duct UV disinfection systems](#) can be installed to disinfect the air as it passes through the HVAC unit and to keep the coils and drain pans free of any type of pathogen, including viruses, bacteria and mold. In-duct UV disinfection is generally only applicable to common area systems due to the restricted space and lack of ductwork in the guest room systems. 
- In large areas with high ceilings [Upper Room GUV](#) can be installed for additional protection, killing the airborne viruses as they circulate within the room. These systems are extremely effective at killing airborne virus droplets and aerosols very near to their source. They can only be installed in areas where there is no possibility of human exposure to the UV radiation, generally above 7'-0" above the floor. 




# ENHANCED HVAC INFECTION CONTROL:

## HOTEL HOSPITALITY

- High exposure risk areas like bathrooms, dining areas, gyms and elevators can be fitted with [ionization purification systems](#), either bi-polar or photocatalytic oxidation type, as additional measures to control potential viral spread in these locations.

- Guestroom units that are not capable of handling the added static pressure of increased filtration could be fitted with

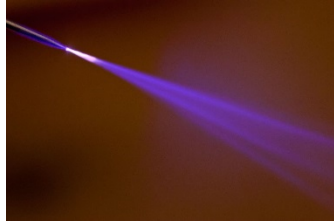

- [Needle Point Bipolar ionization technology](#) to enhance the viral protection in these rooms.


- [Portable UV-C decontamination units](#) can also be used to sterilize guest room surfaces between guest stays. However, careful use and staff training is essential to ensure that there is no human exposure during their operation.



### Summary

Schnackel Engineers can assist you with a thorough evaluation of your building to ensure you are doing everything possible to prevent the spread of viruses within your facility. Please give us a call at 800-581-0963 or email us at [info@schnackel.com](mailto:info@schnackel.com) for a consultation.

### About Pedro:



Pedro Ferrer, P.E. has been involved in the design of mechanical systems for malls, mixed-use developments, corporate offices, national retail roll-outs, commercial and institutional buildings for over 26 years with Schnackel Engineers. Email Pedro at [pferrer@schnackel.com](mailto:pferrer@schnackel.com)

### About Greg:



Gregory Schnackel, P.E., LEED AP has been involved in the design of mechanical, electrical, plumbing, fire protections and information technology systems for malls, mixed-use developments, corporate offices, national retail roll-outs, schools, hospitals, medical facilities, commercial and institutional buildings for over

40 years with Schnackel Engineers. Email Greg at [gschnackel@schnackel.com](mailto:gschnackel@schnackel.com)

RESOURCES	
ASHRAE	<a href="https://www.ashrae.org/">https://www.ashrae.org/</a>
Centers for Disease Control	<a href="https://www.cdc.gov/coronavirus/2019-nCoV/index.html">https://www.cdc.gov/coronavirus/2019-nCoV/index.html</a>
ASHRAE Journal	<a href="https://www.ashrae.org/technical-resources/ashrae-journal">https://www.ashrae.org/technical-resources/ashrae-journal</a>
Schnackel Engineers White Paper Series – Enhanced HVAC Infection Control.	<a href="http://www.schnackel.com/firm/white-papers/enhanced-hvac-infection-control-white-papers">http://www.schnackel.com/firm/white-papers/enhanced-hvac-infection-control-white-papers</a>